


INSTALL #4 REINFORCING BARS, 12" LONG, EMBEDDED 6", AT ALL CONNECTIONS BETWEEN NEW AND EXISTING SIDEWALKS. (TYP. FOR 3) BARS SHALL BE SPACED A MINIMUM OF 6 INCHES FROM EACH OTHER AND FROM EDGES OF WALK.

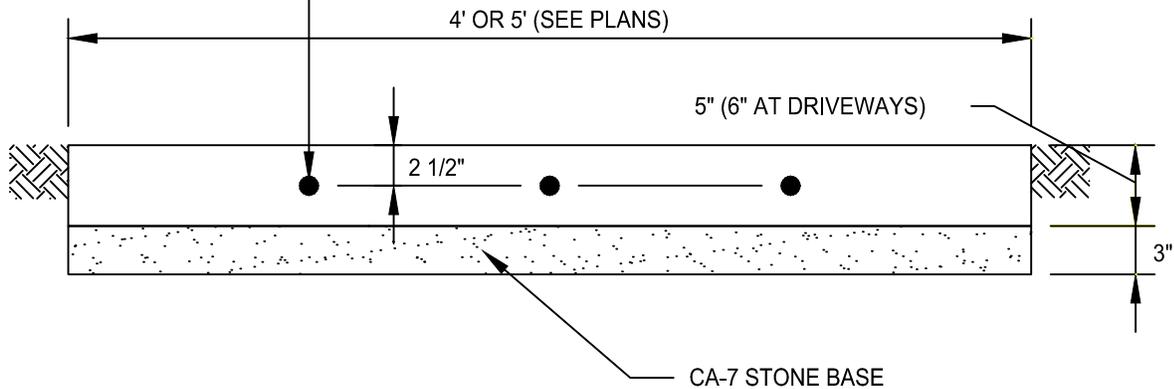

NOTES:

1. SIDEWALKS ADJACENT TO THE BACK OF CURB SHALL BE A MINIMUM OF 6' IN WIDTH.
2. ALL SIDEWALK SHALL BE CONSTRUCTED WITH IDOT CLASS "SI" CONCRETE WITH A MINIMUM COMPRESSIVE STRENGTH OF 3,500 PSI AT 14 DAYS
3. PREFORMED EXPANSION JOINTS (1/2" THICK) SHALL BE CONSTRUCTED IN SIDEWALK EVERY 50 FEET AND AT ALL ABUTTING DRIVEWAYS AND CURB AND GUTTER.
4. TOOLED CONTRACTION JOINTS SHALL BE CONSTRUCTED IN SIDEWALK EVERY FIVE FEET.
5. SIDEWALK SHALL HAVE 1/4" PER FOOT CROSS-SLOPE.
6. SIDEWALKS SHALL BE TESTED PER VILLAGE CODE 11-6-6(B).
7. WELDED WIIRE MESH SHALL BE INSTALLED AT ALL DRIVEWAY CROSSINGS.

VILLAGE OF NEW LENOX
STANDARD DETAIL
FOR
SIDEWALK

REV:	4
DATE:	AUG 2014
FILE:	MISC\SIDEWALK