


NOTES:

1. CONCENTRIC CONE REQUIRED (ECCENTRIC CONE FOR BUTTERFLY VALVES)
2. USE 4'-0" DIAMETER FOR WATER MAIN SIZES 8" OR LESS,
USE 6'-0" DIAMETER FOR WATER MAIN SIZES 10" THRU 12",
FOR WATER MAIN SIZES GREATER THAN 12" THE VAULT SIZE WILL BE DETERMINED AT PLAN REVIEW.
3. ALL MATERIALS MUST BE "MADE IN USA".

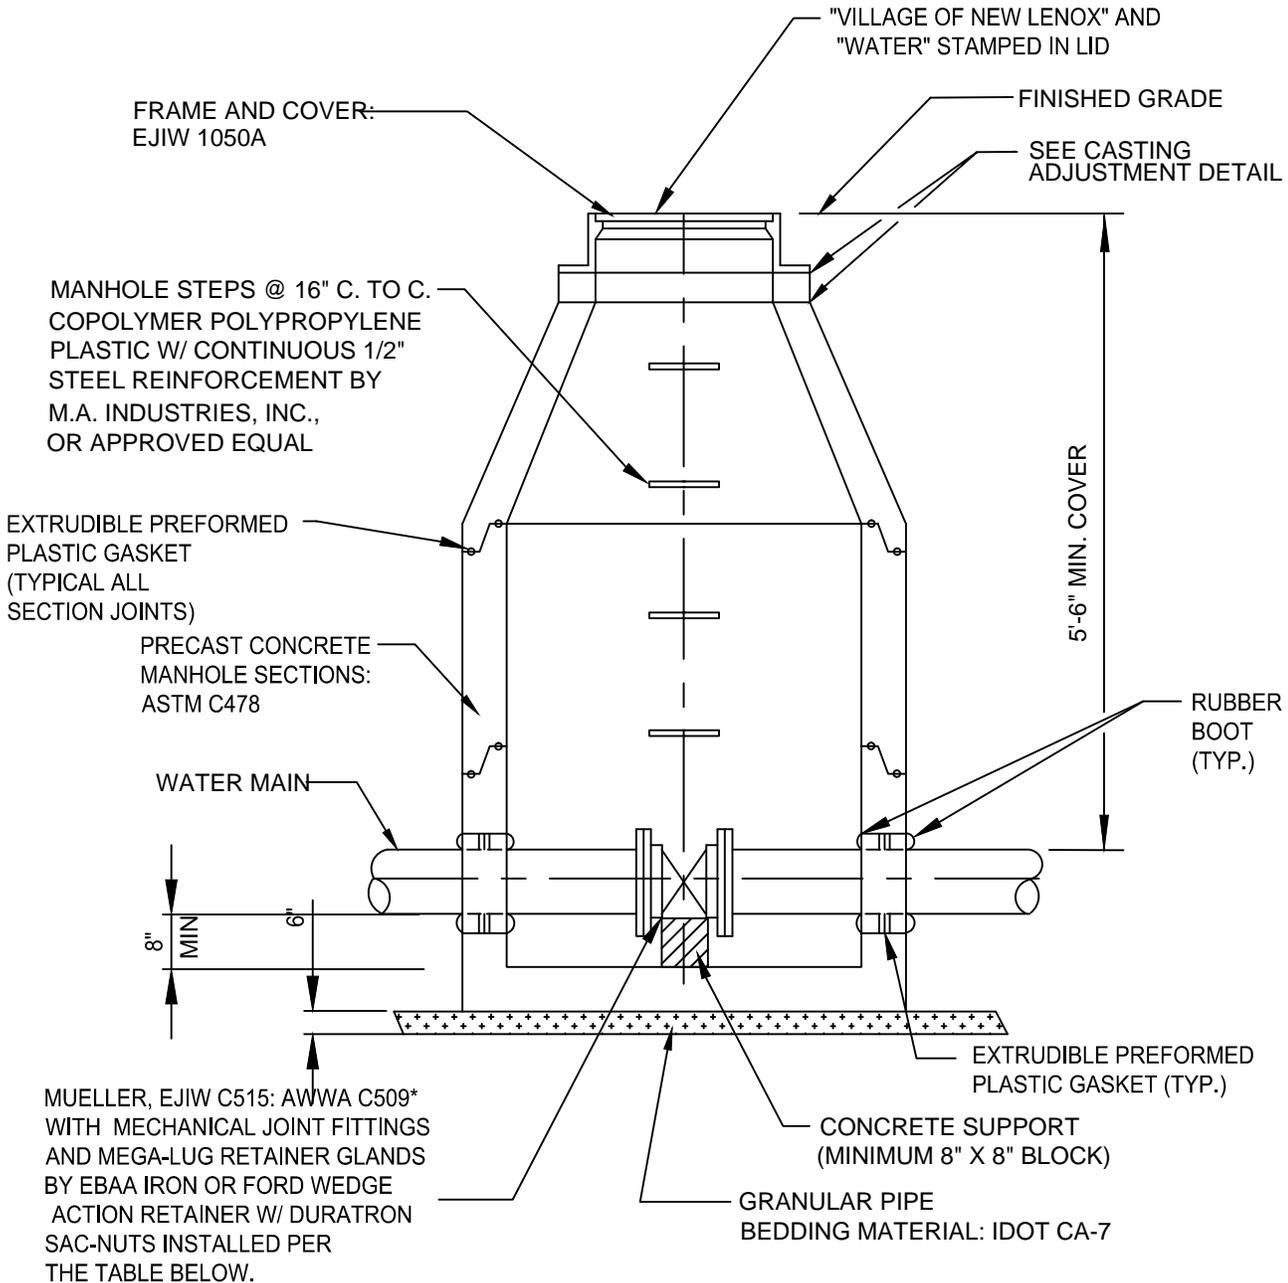

NOMINAL PIPE SIZE (INCHES)	NUMBER OF SAC-NUTS
3	2
4	2
6	3
8	3
10	4
12	4
14	5
16	6
18	6
20	7
24	8

NO SCALE

* VALVES 16" AND LARGER SHALL BE PRATT BUTTERFLY VALVES PER AWWA C504

**VILLAGE OF NEW LENOX
STANDARD DETAIL
FOR
STANDARD VALVE**

REV:	6
DATE:	AUGUST 2014
FILE:	WATER/STANVAVT